



## IES INDOOR REPORT

PHOTOMETRIC FILENAME : PBL G2 2 MD UV 835.IES

### DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001249-009-R01(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 3/18/2020

[MANUFAC] Lumen Focus, LLC

[LUMCAT] PBL G2 2 MD UV 835

[LUMINAIRE] Surface/pendant mounted, formed white enamel aluminum housing/reflectors,

[MORE] no enclosure.

[LAMP] 224 white LEDs, two 20103 3500K 3437A1 LED boards with 112 LEDs each.

[BALLAST] One ULT Everline D21CC80UNVPW-C programmed at 1460mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

[LAMPCAT]

[BALLASTCAT]

### CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	11707
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	164
Total Luminaire Watts	71.3
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.30
Spacing Criterion (90-270)	1.28
Spacing Criterion (Diagonal)	1.40
Basic Luminous Shape	Rectangular
Luminous Length (0-180)	2.00 ft
Luminous Width (90-270)	0.92 ft
Luminous Height	0.00 ft

### LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	23683	23165	23143
55	22912	22597	22834
65	21107	21392	22604
75	17010	18522	14100
85	6508	4089	4953

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : PBL G2 2 MD UV 835.IES**

**ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	1480.38	N.A.	12.60
0-30	3155.65	N.A.	27.00
0-40	5204.16	N.A.	44.50
0-60	9339.01	N.A.	79.80
0-80	11595.38	N.A.	99.00
0-90	11703.24	N.A.	100.00
10-90	11320.06	N.A.	96.70
20-40	3723.79	N.A.	31.80
20-50	5882.98	N.A.	50.30
40-70	5666.9	N.A.	48.40
60-80	2256.38	N.A.	19.30
70-80	724.32	N.A.	6.20
80-90	107.86	N.A.	0.90
90-110	3.36	N.A.	0.00
90-120	3.36	N.A.	0.00
90-130	3.36	N.A.	0.00
90-150	3.36	N.A.	0.00
90-180	3.36	N.A.	0.00
110-180	0.00	N.A.	0.00
0-180	11706.6	N.A.	100.00

Total Luminaire Efficiency = N.A. %

**ZONAL LUMEN SUMMARY**

Zone	Lumens
0-10	383.18
10-20	1097.2
20-30	1675.27
30-40	2048.52
40-50	2159.2
50-60	1975.64
60-70	1532.06
70-80	724.32
80-90	107.86
90-100	3.00
100-110	0.36
110-120	0.00
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : PBL G2 2 MD UV 835.IES**

**COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD**

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	109	104	100	97	106	102	98	95	98	95	92	94	91	89	90	88	87	84
2	99	91	84	79	97	89	83	78	86	80	76	82	78	74	79	76	72	70
3	90	80	72	65	88	78	71	65	75	69	63	72	67	62	70	65	61	59
4	83	71	62	55	80	69	61	55	67	60	54	64	58	53	62	57	52	50
5	76	63	54	47	74	62	53	47	60	52	46	58	51	46	56	50	45	43
6	70	57	48	41	68	56	47	41	54	46	41	52	45	40	51	45	40	38
7	65	51	42	36	63	50	42	36	49	41	36	47	41	36	46	40	35	33
8	60	47	38	32	59	46	38	32	45	37	32	43	37	32	42	36	32	30
9	56	43	35	29	55	42	34	29	41	34	29	40	33	29	39	33	28	27
10	53	39	32	26	51	39	31	26	38	31	26	37	30	26	36	30	26	24


**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : PBL G2 2 MD UV 835.IES**

**UGR TABLE - CORRECTED**

Reflectances											
Ceiling Cavity	70	70	50	50	30	70	70	50	50	30	
Walls	50	30	50	30	30	50	30	50	30	30	
Floor Cavity	20	20	20	20	20	20	20	20	20	20	
Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	23.0	24.7	23.4	25.0	25.3	23.3	25.0	23.7	25.3	25.6
	3H	24.8	26.3	25.2	26.6	27.0	25.4	26.9	25.7	27.2	27.5
	4H	25.5	26.8	25.8	27.2	27.6	25.7	27.1	26.1	27.4	27.8
	6H	25.8	27.1	26.2	27.5	27.9	25.7	27.0	26.1	27.3	27.7
	8H	25.9	27.1	26.3	27.5	27.9	25.7	26.9	26.1	27.3	27.7
	12H	25.9	27.1	26.4	27.5	27.9	25.6	26.8	26.1	27.2	27.6
4H	2H	23.7	25.1	24.1	25.5	25.9	24.0	25.3	24.4	25.7	26.1
	3H	25.7	26.9	26.1	27.3	27.7	26.2	27.3	26.6	27.7	28.1
	4H	26.4	27.5	26.9	27.9	28.4	26.5	27.6	27.0	28.0	28.4
	6H	27.0	27.9	27.4	28.3	28.8	26.6	27.5	27.0	27.9	28.4
	8H	27.1	27.9	27.6	28.4	28.9	26.6	27.4	27.0	27.9	28.3
	12H	27.1	27.9	27.6	28.4	28.8	26.6	27.3	27.0	27.8	28.3
8H	4H	26.7	27.6	27.2	28.0	28.5	26.8	27.7	27.3	28.1	28.6
	6H	27.3	28.0	27.8	28.5	29.0	26.8	27.6	27.3	28.0	28.5
	8H	27.5	28.1	28.0	28.6	29.1	26.8	27.5	27.3	28.0	28.5
	12H	27.5	28.1	28.1	28.6	29.2	26.8	27.4	27.3	27.9	28.4
12H	4H	26.7	27.5	27.2	27.9	28.4	26.8	27.6	27.3	28.1	28.5
	6H	27.3	27.9	27.8	28.4	28.9	26.9	27.5	27.4	28.0	28.5
	8H	27.5	28.0	28.0	28.5	29.1	26.9	27.4	27.4	27.9	28.5

Maximum UGR = 29.2

POLAR GRAPH

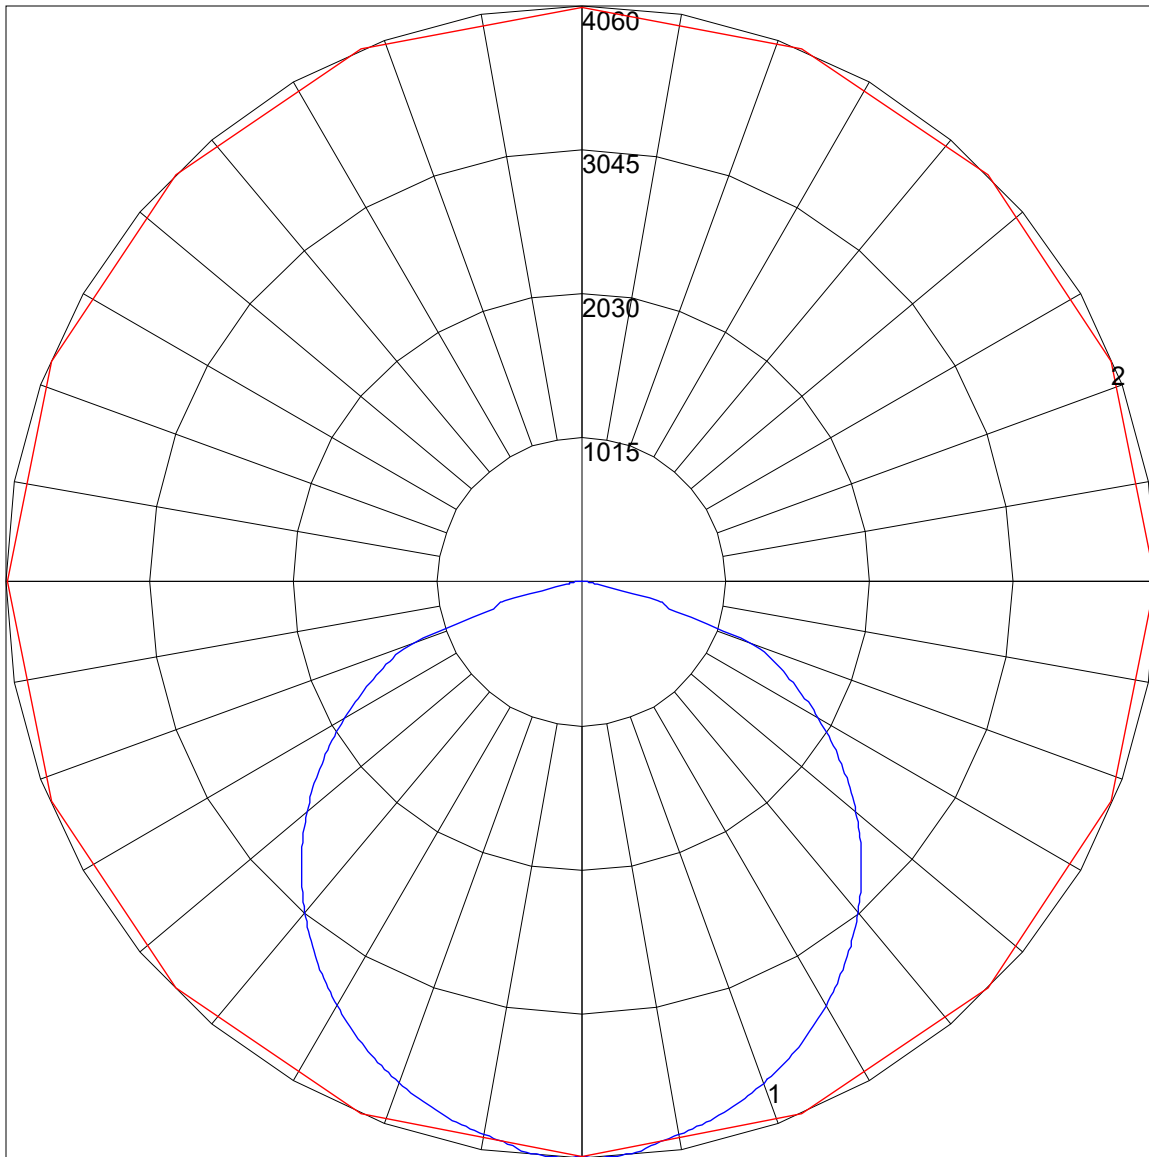

Maximum Candela = 4059.657 Located At Horizontal Angle = 67.5, Vertical Angle = 1.5  
# 1 - Vertical Plane Through Horizontal Angles (67.5 - 247.5) (Through Max. Cd.)  
# 2 - Horizontal Cone Through Vertical Angle (1.5) (Through Max. Cd.)