



## IES INDOOR REPORT

PHOTOMETRIC FILENAME : PBL G2 2W SH UV 840.IES

### DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001249-003(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 3/18/2020

[MANUFAC] Lumen Focus, LLC

[LUMCAT] PBL G2 2W SH UV 840

[LUMINAIRE] Surface/pendant mounted, formed white enamel aluminum housing/reflectors,

[MORE] no enclosure.

[LAMP] 448 white LEDs, four 20103 4000K 3437A1 LED boards with 112 LEDs

[MORE] each.

[BALLAST] Two ULT Everline D21CC80UNVPW-C LED drivers each programmed at

[MORE] 1460mA

[OTHER] 120.0Vac, 60.00Hz, 1.191A, 142.5W, 0.997PF, 5.9%THD(i)

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

### CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	24299
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	171
Total Luminaire Watts	142.49
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.30
Spacing Criterion (90-270)	1.28
Spacing Criterion (Diagonal)	1.42
Basic Luminous Shape	Rectangular
Luminous Length (0-180)	2.00 ft
Luminous Width (90-270)	1.25 ft
Luminous Height	0.00 ft

### LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	35388	35130	35124
55	34351	34336	34522
65	31250	32241	33169
75	25255	28423	24067
85	10174	9816	11247

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : PBL G2 2W SH UV 840.IES**

**ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	3035.89	N.A.	12.50
0-30	6485.59	N.A.	26.70
0-40	10708.51	N.A.	44.10
0-60	19249.94	N.A.	79.20
0-80	24005.37	N.A.	98.80
0-90	24294.56	N.A.	100.00
10-90	23511.83	N.A.	96.80
20-40	7672.62	N.A.	31.60
20-50	12130.55	N.A.	49.90
40-70	11669.04	N.A.	48.00
60-80	4755.43	N.A.	19.60
70-80	1627.82	N.A.	6.70
80-90	289.20	N.A.	1.20
90-110	4.07	N.A.	0.00
90-120	4.07	N.A.	0.00
90-130	4.07	N.A.	0.00
90-150	4.07	N.A.	0.00
90-180	4.07	N.A.	0.00
110-180	0.00	N.A.	0.00
0-180	24298.63	N.A.	100.00

Total Luminaire Efficiency = N.A. %

**ZONAL LUMEN SUMMARY**

Zone	Lumens
0-10	782.73
10-20	2253.16
20-30	3449.7
30-40	4222.92
40-50	4457.92
50-60	4083.5
60-70	3127.61
70-80	1627.82
80-90	289.20
90-100	3.87
100-110	0.20
110-120	0.00
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : PBL G2 2W SH UV 840.IES**

**COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD**

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	109	104	100	96	106	102	98	95	98	95	92	94	91	89	90	88	86	84
2	99	91	84	78	96	89	83	77	85	80	75	82	78	74	79	75	72	70
3	90	79	71	65	88	78	70	64	75	68	63	72	67	62	70	65	61	59
4	82	70	61	55	80	69	61	54	66	59	54	64	58	53	62	57	52	50
5	76	63	54	47	74	62	53	47	59	52	46	57	51	46	56	50	45	43
6	70	56	47	41	68	55	47	41	54	46	40	52	45	40	50	44	40	37
7	65	51	42	36	63	50	42	36	49	41	36	47	40	35	46	40	35	33
8	60	46	38	32	59	46	38	32	44	37	32	43	36	31	42	36	31	29
9	56	43	34	29	55	42	34	29	41	34	28	40	33	28	39	33	28	26
10	53	39	31	26	51	39	31	26	38	31	26	37	30	26	36	30	26	24


**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : PBL G2 2W SH UV 840.IES**

**UGR TABLE - CORRECTED**

Reflectances											
Ceiling Cavity	70	70	50	50	30	70	70	50	50	30	
Walls	50	30	50	30	30	50	30	50	30	30	
Floor Cavity	20	20	20	20	20	20	20	20	20	20	
Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	24.5	26.2	24.9	26.5	26.8	24.7	26.3	25.0	26.6	26.9
	3H	26.2	27.7	26.6	28.1	28.4	26.6	28.1	27.0	28.4	28.8
	4H	26.8	28.2	27.2	28.6	29.0	27.1	28.5	27.5	28.8	29.2
	6H	27.2	28.5	27.6	28.9	29.2	27.2	28.5	27.6	28.9	29.3
	8H	27.3	28.5	27.7	28.9	29.3	27.3	28.5	27.7	28.9	29.3
	12H	27.3	28.5	27.7	28.9	29.3	27.3	28.5	27.7	28.9	29.3
4H	2H	25.2	26.6	25.6	26.9	27.3	25.3	26.7	25.7	27.1	27.4
	3H	27.1	28.3	27.5	28.7	29.1	27.5	28.7	27.9	29.1	29.5
	4H	27.8	28.9	28.3	29.3	29.7	28.0	29.1	28.5	29.5	29.9
	6H	28.3	29.2	28.7	29.7	30.1	28.3	29.2	28.7	29.7	30.1
	8H	28.4	29.3	28.9	29.7	30.2	28.3	29.2	28.8	29.6	30.1
	12H	28.4	29.2	28.9	29.7	30.2	28.4	29.1	28.8	29.6	30.1
8H	4H	28.1	29.0	28.6	29.4	29.9	28.3	29.2	28.7	29.6	30.1
	6H	28.7	29.4	29.2	29.9	30.4	28.6	29.3	29.1	29.8	30.3
	8H	28.8	29.5	29.4	30.0	30.5	28.7	29.3	29.2	29.8	30.3
	12H	28.9	29.5	29.4	30.0	30.5	28.7	29.3	29.2	29.8	30.4
12H	4H	28.1	28.9	28.6	29.4	29.8	28.3	29.1	28.8	29.6	30.0
	6H	28.7	29.3	29.2	29.8	30.3	28.6	29.3	29.1	29.7	30.3
	8H	28.9	29.5	29.4	29.9	30.5	28.7	29.3	29.2	29.8	30.3

Maximum UGR = 30.5

POLAR GRAPH

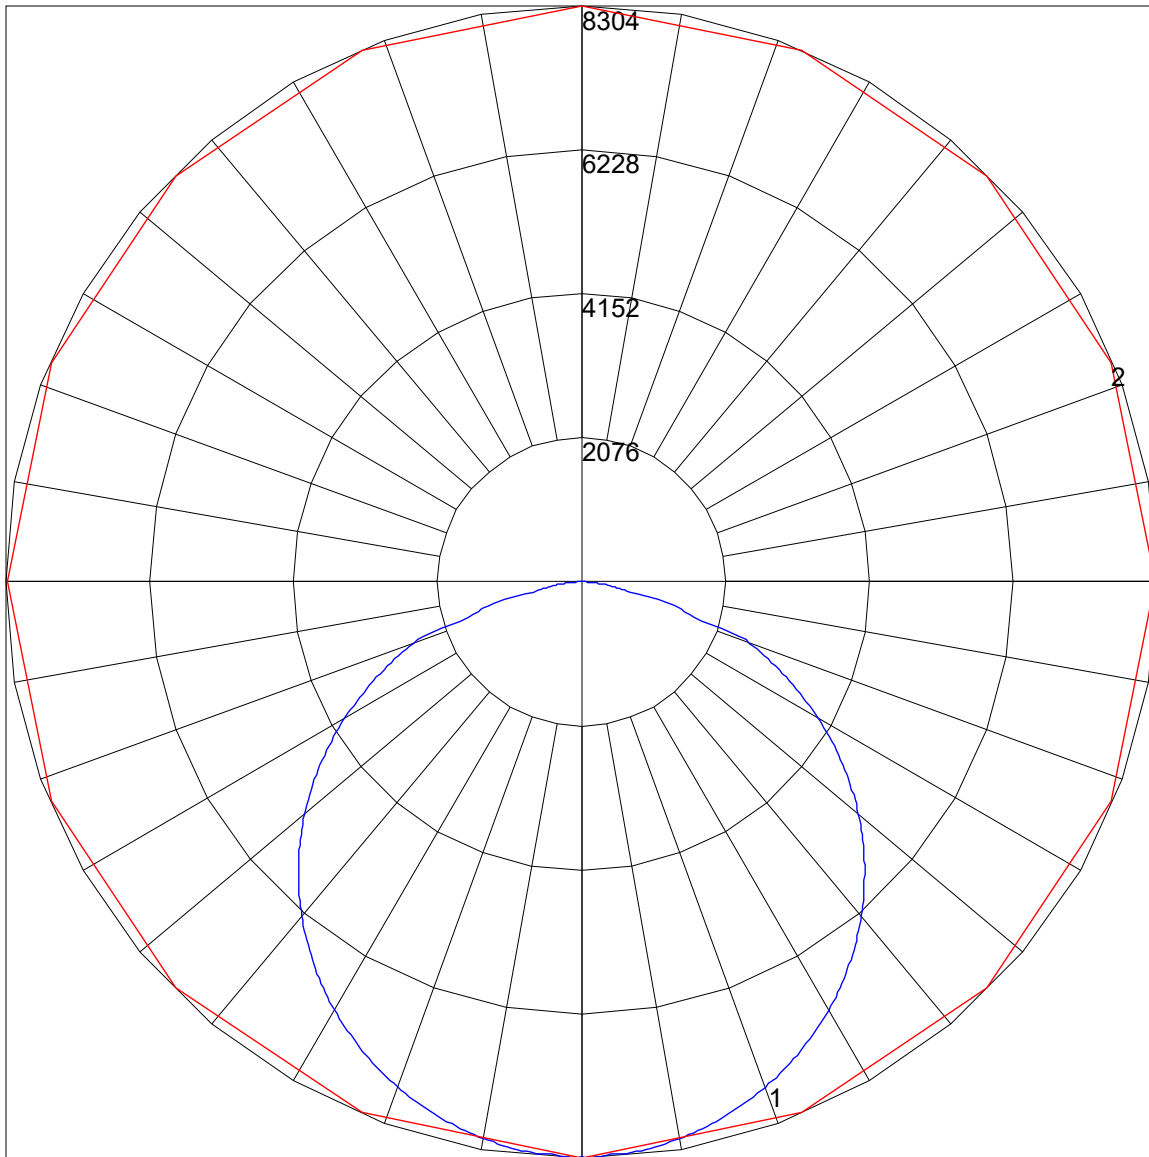

Maximum Candela = 8304.33 Located At Horizontal Angle = 90, Vertical Angle = .5  
# 1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)  
# 2 - Horizontal Cone Through Vertical Angle (.5) (Through Max. Cd.)