



## IES INDOOR REPORT

PHOTOMETRIC FILENAME : PBL G2 4 MD UV FR 835.IES

### DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001249-010A(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 3/18/2020

[MANUFAC] Lumen Focus, LLC

[LUMCAT] PBL G2 4 MD UV FR 835

[LUMINAIRE] Surface/pendant mounted, formed white enamel aluminum housing/reflectors,

[MORE] frosted plastic enclosures below LEDs.

[LAMP] 448 white LEDs, four 20103 3500K 3437A1 LED boards with 112 LEDs

[MORE] each.

[BALLAST] Two ULT Everline D15CC55UNVPW-C LED drivers each programmed at 1200mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

### CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	18296
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	156
Total Luminaire Watts	117.3
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.26
Spacing Criterion (90-270)	1.28
Spacing Criterion (Diagonal)	1.38
Basic Luminous Shape	Rectangular
Luminous Length (0-180)	3.79 ft
Luminous Width (90-270)	0.92 ft
Luminous Height	0.00 ft

### LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	17887	18914	19645
55	15699	18235	19485
65	12844	17530	18996
75	9693	15312	12095
85	6266	11285	8737

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : PBL G2 4 MD UV FR 835.IES**

**ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	2387.54	N.A.	13.00
0-30	5067.78	N.A.	27.70
0-40	8291.43	N.A.	45.30
0-60	14575.66	N.A.	79.70
0-80	17984.82	N.A.	98.30
0-90	18292.84	N.A.	100.00
10-90	17674.68	N.A.	96.60
20-40	5903.89	N.A.	32.30
20-50	9223.05	N.A.	50.40
40-70	8529.51	N.A.	46.60
60-80	3409.15	N.A.	18.60
70-80	1163.87	N.A.	6.40
80-90	308.02	N.A.	1.70
90-110	2.67	N.A.	0.00
90-120	2.67	N.A.	0.00
90-130	2.67	N.A.	0.00
90-150	2.67	N.A.	0.00
90-180	2.67	N.A.	0.00
110-180	0.00	N.A.	0.00
0-180	18295.51	N.A.	100.00

Total Luminaire Efficiency = N.A. %

**ZONAL LUMEN SUMMARY**

Zone	Lumens
0-10	618.16
10-20	1769.38
20-30	2680.24
30-40	3223.65
40-50	3319.16
50-60	2965.07
60-70	2245.28
70-80	1163.87
80-90	308.02
90-100	2.50
100-110	0.17
110-120	0.00
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : PBL G2 4 MD UV FR 835.IES**

**COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD**

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	109	104	100	96	106	102	98	95	98	94	92	94	91	89	90	88	86	84
2	99	91	84	78	96	89	83	77	85	80	76	82	78	74	79	75	72	70
3	90	80	72	65	88	78	71	65	75	69	63	72	67	62	70	65	61	59
4	83	71	62	55	80	69	61	55	67	60	54	65	58	53	62	57	53	50
5	76	63	54	48	74	62	54	47	60	52	47	58	51	46	56	50	46	44
6	70	57	48	41	68	56	47	41	54	47	41	52	46	41	51	45	40	38
7	65	52	43	37	63	51	42	36	49	42	36	48	41	36	46	40	36	34
8	61	47	39	33	59	46	38	33	45	38	32	44	37	32	43	36	32	30
9	57	43	35	29	55	43	35	29	41	34	29	40	34	29	39	33	29	27
10	53	40	32	27	52	39	32	27	38	31	26	37	31	26	36	31	26	24


**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : PBL G2 4 MD UV FR 835.IES**

**UGR TABLE - CORRECTED**

Reflectances											
Ceiling Cavity		70	70	50	50	30	70	70	50	50	30
Walls		50	30	50	30	30	50	30	50	30	30
Floor Cavity		20	20	20	20	20	20	20	20	20	20
Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	21.4	23.0	21.8	23.3	23.7	22.8	24.5	23.2	24.8	25.1
	3H	22.9	24.4	23.3	24.7	25.1	24.6	26.1	25.0	26.4	26.8
	4H	23.4	24.8	23.8	25.1	25.5	25.0	26.4	25.4	26.8	27.1
	6H	23.7	25.0	24.1	25.4	25.8	25.3	26.6	25.7	26.9	27.3
	8H	23.8	25.1	24.3	25.4	25.8	25.4	26.6	25.8	27.0	27.4
	12H	23.9	25.1	24.3	25.4	25.9	25.4	26.6	25.8	27.0	27.4
4H	2H	22.3	23.7	22.7	24.0	24.4	23.4	24.8	23.8	25.1	25.5
	3H	24.0	25.2	24.5	25.6	26.0	25.4	26.6	25.8	27.0	27.4
	4H	24.7	25.7	25.1	26.1	26.6	25.9	27.0	26.4	27.4	27.8
	6H	25.1	26.1	25.6	26.5	27.0	26.3	27.2	26.7	27.6	28.1
	8H	25.3	26.1	25.8	26.6	27.1	26.4	27.3	26.9	27.7	28.2
	12H	25.4	26.1	25.9	26.6	27.1	26.5	27.2	27.0	27.7	28.2
8H	4H	25.1	26.0	25.6	26.4	26.9	26.2	27.1	26.7	27.5	28.0
	6H	25.7	26.4	26.2	26.9	27.4	26.6	27.4	27.1	27.9	28.3
	8H	26.0	26.6	26.5	27.1	27.6	26.8	27.5	27.3	28.0	28.4
	12H	26.1	26.7	26.6	27.2	27.7	27.0	27.5	27.5	28.0	28.6
12H	4H	25.2	25.9	25.6	26.4	26.9	26.2	27.0	26.7	27.5	27.9
	6H	25.8	26.5	26.3	26.9	27.5	26.7	27.4	27.2	27.8	28.4
	8H	26.1	26.7	26.6	27.1	27.7	26.9	27.5	27.4	28.0	28.5

Maximum UGR = 28.6

POLAR GRAPH

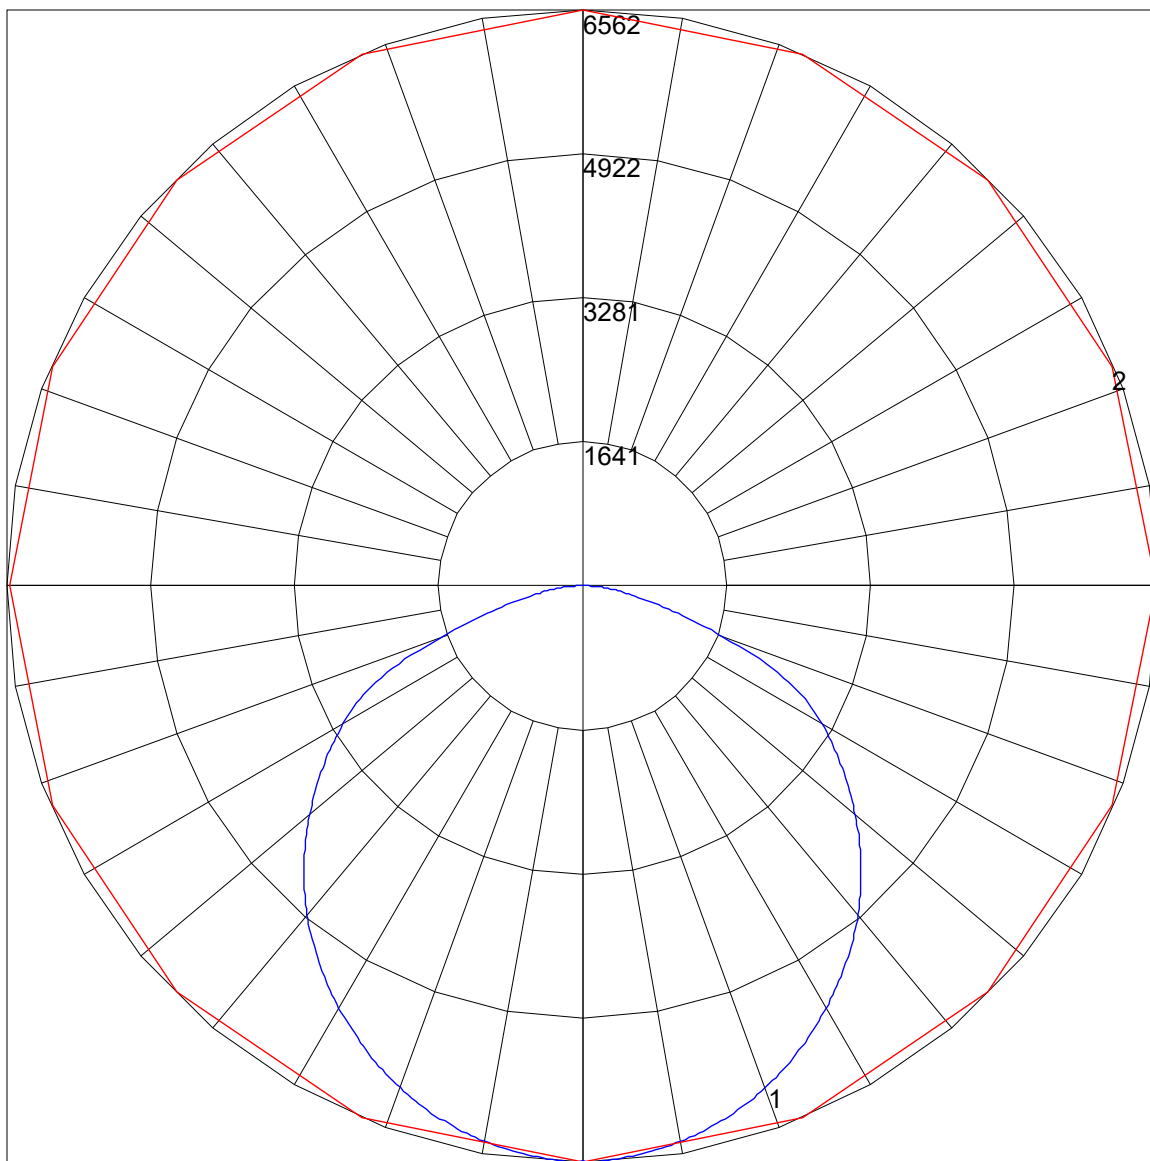

Maximum Candela = 6562.151 Located At Horizontal Angle = 90, Vertical Angle = .5  
# 1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)  
# 2 - Horizontal Cone Through Vertical Angle (.5) (Through Max. Cd.)