

## IES INDOOR REPORT

PHOTOMETRIC FILENAME : PBL G2 4 HI HE UV FR 850.IES

### DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001249-010A(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 3/18/2020

[MANUFAC] Lumen Focus, LLC

[LUMCAT] PBL G2 4 HI HE UV FR 850

[LUMINAIRE] Surface/pendant mounted, formed white enamel aluminum housing/reflectors,  
[MORE] frosted plastic enclosures below LEDs.

[LAMP] 672 white LEDs, six 20103 5000K 3437A1 LED boards with 112 LEDs  
[MORE] each.

[BALLAST] Two ULT Everline D21CC80UNVPW-C LED drivers each programmed at 1460mA

[OTHER] 120.0Vac, 60.00Hz

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

### CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	23337
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	166
Total Luminaire Watts	140.3
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.26
Spacing Criterion (90-270)	1.28
Spacing Criterion (Diagonal)	1.38
Basic Luminous Shape	Rectangular
Luminous Length (0-180)	3.79 ft
Luminous Width (90-270)	0.92 ft
Luminous Height	0.00 ft

### LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	22816	24126	25059
55	20026	23260	24855
65	16384	22361	24231
75	12364	19531	15428
85	7993	14394	11145

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : PBL G2 4 HI HE UV FR 850.IES**

**ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	3045.49	N.A.	13.00
0-30	6464.35	N.A.	27.70
0-40	10576.37	N.A.	45.30
0-60	18592.4	N.A.	79.70
0-80	22941.04	N.A.	98.30
0-90	23333.95	N.A.	100.00
10-90	22545.43	N.A.	96.60
20-40	7530.88	N.A.	32.30
20-50	11764.73	N.A.	50.40
40-70	10880.06	N.A.	46.60
60-80	4348.64	N.A.	18.60
70-80	1484.61	N.A.	6.40
80-90	392.91	N.A.	1.70
90-110	3.41	N.A.	0.00
90-120	3.41	N.A.	0.00
90-130	3.41	N.A.	0.00
90-150	3.41	N.A.	0.00
90-180	3.41	N.A.	0.00
110-180	0.00	N.A.	0.00
0-180	23337.36	N.A.	100.00

Total Luminaire Efficiency = N.A. %

**ZONAL LUMEN SUMMARY**

Zone	Lumens
0-10	788.52
10-20	2256.98
20-30	3418.85
30-40	4112.02
40-50	4233.85
50-60	3782.18
60-70	2864.03
70-80	1484.61
80-90	392.91
90-100	3.19
100-110	0.22
110-120	0.00
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : PBL G2 4 HI HE UV FR 850.IES**

**COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD**

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	109	104	100	96	106	102	98	95	98	94	92	94	91	89	90	88	86	84
2	99	91	84	78	96	89	83	77	85	80	76	82	78	74	79	75	72	70
3	90	80	72	65	88	78	71	65	75	69	63	72	67	62	70	65	61	59
4	83	71	62	55	80	69	61	55	67	60	54	65	58	53	62	57	53	50
5	76	63	54	48	74	62	54	47	60	52	47	58	51	46	56	50	46	44
6	70	57	48	41	68	56	47	41	54	47	41	52	46	41	51	45	40	38
7	65	52	43	37	63	51	42	36	49	42	36	48	41	36	46	40	36	34
8	61	47	39	33	59	46	38	33	45	38	32	44	37	32	43	36	32	30
9	57	43	35	29	55	43	35	29	41	34	29	40	34	29	39	33	29	27
10	53	40	32	27	52	39	32	27	38	31	26	37	31	26	36	31	26	24


**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : PBL G2 4 HI HE UV FR 850.IES**

**UGR TABLE - CORRECTED**

Reflectances											
Ceiling Cavity	70	70	50	50	30	70	70	50	50	30	
Walls	50	30	50	30	30	50	30	50	30	30	
Floor Cavity	20	20	20	20	20	20	20	20	20	20	
Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	22.2	23.8	22.6	24.1	24.5	23.6	25.3	24.0	25.6	25.9
	3H	23.7	25.2	24.1	25.5	25.9	25.4	26.9	25.8	27.2	27.6
	4H	24.2	25.6	24.6	25.9	26.3	25.8	27.2	26.2	27.6	27.9
	6H	24.5	25.8	24.9	26.2	26.6	26.1	27.4	26.5	27.7	28.1
	8H	24.6	25.9	25.1	26.2	26.6	26.2	27.4	26.6	27.8	28.2
	12H	24.7	25.9	25.1	26.2	26.7	26.2	27.4	26.6	27.8	28.2
4H	2H	23.1	24.5	23.5	24.8	25.2	24.2	25.6	24.6	25.9	26.3
	3H	24.8	26.0	25.3	26.4	26.8	26.2	27.4	26.6	27.8	28.2
	4H	25.5	26.5	25.9	26.9	27.4	26.7	27.8	27.2	28.2	28.6
	6H	25.9	26.9	26.4	27.3	27.8	27.1	28.0	27.5	28.4	28.9
	8H	26.1	26.9	26.6	27.4	27.9	27.2	28.1	27.7	28.5	29.0
	12H	26.2	26.9	26.7	27.4	27.9	27.3	28.0	27.8	28.5	29.0
8H	4H	25.9	26.8	26.4	27.2	27.7	27.0	27.9	27.5	28.3	28.8
	6H	26.5	27.2	27.0	27.7	28.2	27.4	28.2	27.9	28.7	29.1
	8H	26.8	27.4	27.3	27.9	28.4	27.6	28.3	28.1	28.8	29.2
	12H	26.9	27.5	27.4	28.0	28.5	27.8	28.3	28.3	28.8	29.4
12H	4H	26.0	26.7	26.4	27.2	27.7	27.0	27.8	27.5	28.3	28.7
	6H	26.6	27.3	27.1	27.7	28.3	27.5	28.2	28.0	28.6	29.2
	8H	26.9	27.5	27.4	27.9	28.5	27.7	28.3	28.2	28.8	29.3

Maximum UGR = 29.4

POLAR GRAPH

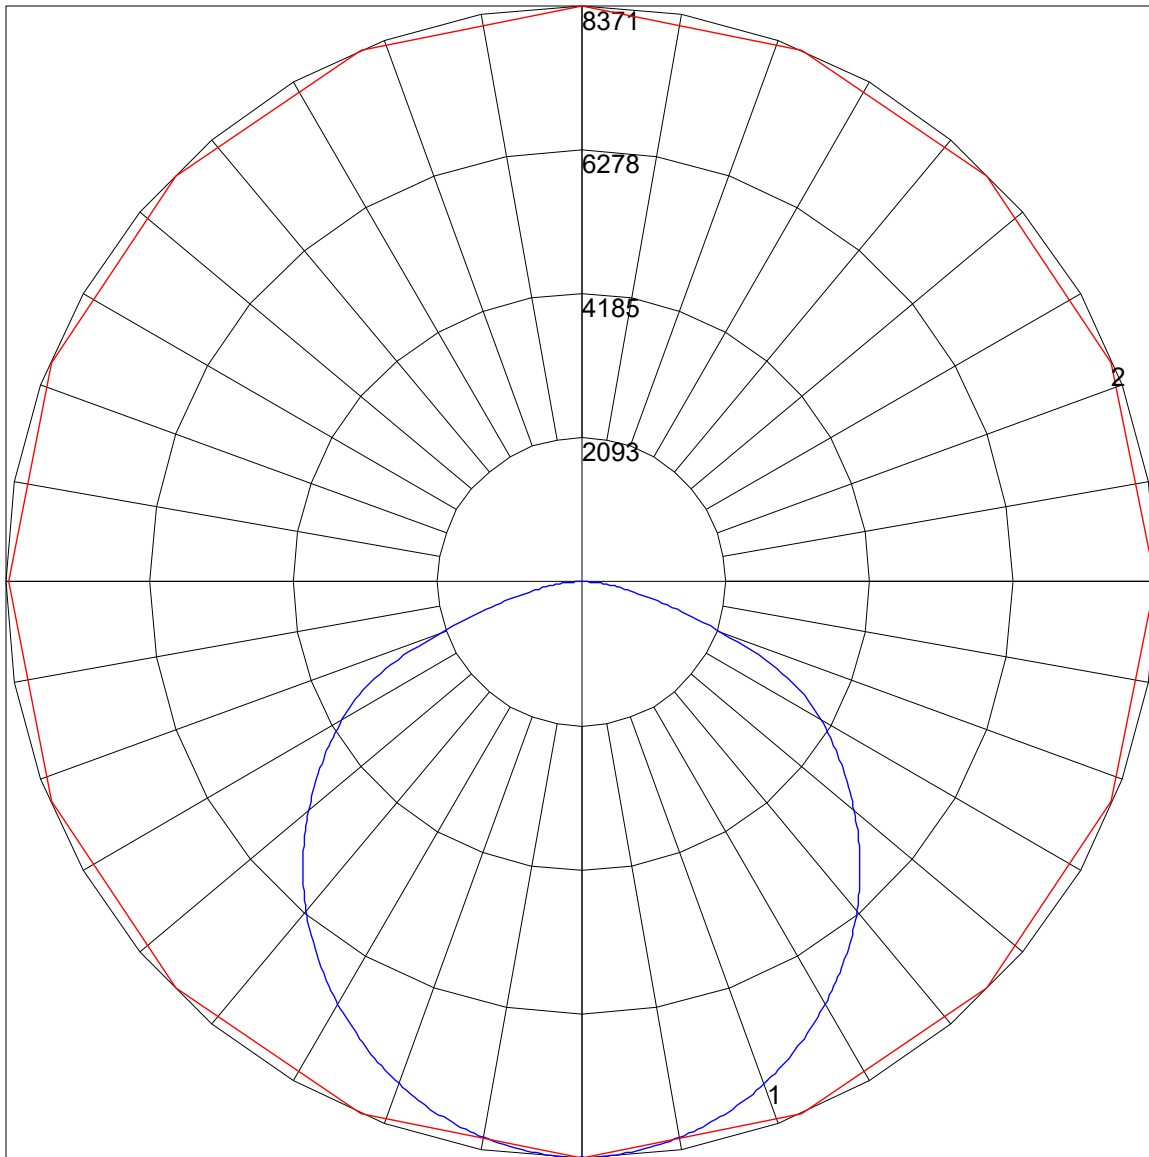

Maximum Candela = 8370.537 Located At Horizontal Angle = 90, Vertical Angle = .5  
# 1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)  
# 2 - Horizontal Cone Through Vertical Angle (.5) (Through Max. Cd.)