



IES INDOOR REPORT

PHOTOMETRIC FILENAME : PBL G2 4W HI UV 840.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] LLIA001249-018(s)

[TESTLAB] LightLab International Allentown, LLC

[ISSUE DATE] 3/24/2020

[MANUFAC] Lumen Focus, LLC

[LUMCAT] PBL G2 4W HI UV 840

[LUMINAIRE] Surface/pendant mounted, formed white enamel aluminum housing/reflectors,

[MORE] no enclosure.

[LAMP] 672 white LEDs, six 20103 4000K 3437A1 LED boards with 112 LEDs each.

[BALLAST] Three ULT Everline D21CC80UNVPW-C LED drivers each programmed

[MORE] at 1660mA

[OTHER] 120.0Vac, 60.00Hz, 2.045A, 244.7W, 0.997PF, 5.3%THD(i)

[OTHER] This test was performed using the absolute method of photometry.

[MORE] Lamp lumens value was set to -1

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	41339
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	169
Total Luminaire Watts	244.71
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.30
Spacing Criterion (90-270)	1.28
Spacing Criterion (Diagonal)	1.42
Basic Luminous Shape	Rectangular
Luminous Length (0-180)	3.79 ft
Luminous Width (90-270)	1.25 ft
Luminous Height	0.00 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	31689	31377	31533
55	30827	30680	31040
65	28704	29060	30017
75	24116	26659	20557
85	12322	8251	9087

IES INDOOR REPORT
PHOTOMETRIC FILENAME : PBL G2 4W HI UV 840.IES

ZONAL LUMEN SUMMARY

Zone	Lumens	%Lamp	%Fixt
0-20	5159.49	N.A.	12.50
0-30	11020.05	N.A.	26.70
0-40	18189.68	N.A.	44.00
0-60	32685.7	N.A.	79.10
0-80	40843.57	N.A.	98.80
0-90	41333.52	N.A.	100.00
10-90	40002.82	N.A.	96.80
20-40	13030.18	N.A.	31.50
20-50	20589.43	N.A.	49.80
40-70	19865.94	N.A.	48.10
60-80	8157.88	N.A.	19.70
70-80	2787.95	N.A.	6.70
80-90	489.95	N.A.	1.20
90-110	5.09	N.A.	0.00
90-120	5.09	N.A.	0.00
90-130	5.09	N.A.	0.00
90-150	5.09	N.A.	0.00
90-180	5.09	N.A.	0.00
110-180	0.00	N.A.	0.00
0-180	41338.61	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	1330.7
10-20	3828.79
20-30	5860.56
30-40	7169.63
40-50	7559.25
50-60	6936.77
60-70	5369.92
70-80	2787.95
80-90	489.95
90-100	5.06
100-110	0.02
110-120	0.00
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00

IES INDOOR REPORT
PHOTOMETRIC FILENAME : PBL G2 4W HI UV 840.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	109	104	100	96	106	102	98	95	98	94	92	94	91	89	90	88	86	84
2	99	91	84	78	96	89	82	77	85	80	75	82	77	74	79	75	72	70
3	90	79	71	65	88	78	70	64	75	68	63	72	67	62	70	65	61	59
4	82	70	61	55	80	69	61	54	66	59	53	64	58	53	62	56	52	50
5	76	63	54	47	73	61	53	47	59	52	46	57	51	46	55	50	45	43
6	70	56	47	41	68	55	47	41	53	46	40	52	45	40	50	44	39	37
7	65	51	42	36	63	50	42	36	49	41	35	47	40	35	46	40	35	33
8	60	46	38	32	58	46	38	32	44	37	32	43	36	31	42	36	31	29
9	56	43	34	29	55	42	34	29	41	34	28	40	33	28	39	33	28	26
10	53	39	31	26	51	39	31	26	38	31	26	37	30	26	36	30	26	24


IES INDOOR REPORT
PHOTOMETRIC FILENAME : PBL G2 4W HI UV 840.IES

UGR TABLE - CORRECTED

Reflectances											
Ceiling Cavity		70	70	50	50	30	70	70	50	50	30
Walls		50	30	50	30	30	50	30	50	30	30
Floor Cavity		20	20	20	20	20	20	20	20	20	20
Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	24.1	25.7	24.4	26.0	26.3	24.3	25.9	24.6	26.2	26.5
	3H	25.9	27.4	26.3	27.7	28.1	26.2	27.7	26.6	28.1	28.4
	4H	26.5	27.9	26.9	28.3	28.6	26.6	28.0	27.0	28.4	28.8
	6H	26.9	28.2	27.3	28.6	29.0	26.7	28.1	27.2	28.4	28.8
	8H	27.1	28.3	27.5	28.7	29.1	26.8	28.0	27.2	28.4	28.8
	12H	27.1	28.3	27.5	28.7	29.1	26.8	28.0	27.2	28.3	28.8
4H	2H	24.7	26.1	25.1	26.5	26.9	24.9	26.3	25.3	26.6	27.0
	3H	26.8	27.9	27.2	28.3	28.7	27.1	28.3	27.5	28.7	29.1
	4H	27.5	28.6	28.0	29.0	29.4	27.6	28.7	28.0	29.1	29.5
	6H	28.1	29.0	28.5	29.4	29.9	27.8	28.7	28.2	29.1	29.6
	8H	28.2	29.1	28.7	29.5	30.0	27.8	28.7	28.2	29.1	29.6
	12H	28.3	29.1	28.8	29.5	30.0	27.8	28.6	28.3	29.1	29.5
8H	4H	27.8	28.7	28.3	29.1	29.6	27.9	28.7	28.3	29.2	29.6
	6H	28.5	29.2	28.9	29.7	30.1	28.1	28.8	28.6	29.3	29.8
	8H	28.7	29.3	29.2	29.8	30.3	28.1	28.8	28.6	29.3	29.8
	12H	28.8	29.3	29.3	29.8	30.4	28.2	28.7	28.7	29.2	29.8
12H	4H	27.8	28.6	28.3	29.1	29.5	27.9	28.7	28.4	29.1	29.6
	6H	28.5	29.1	29.0	29.6	30.1	28.1	28.8	28.6	29.2	29.8
	8H	28.7	29.3	29.2	29.8	30.3	28.2	28.7	28.7	29.2	29.8

Maximum UGR = 30.4

POLAR GRAPH

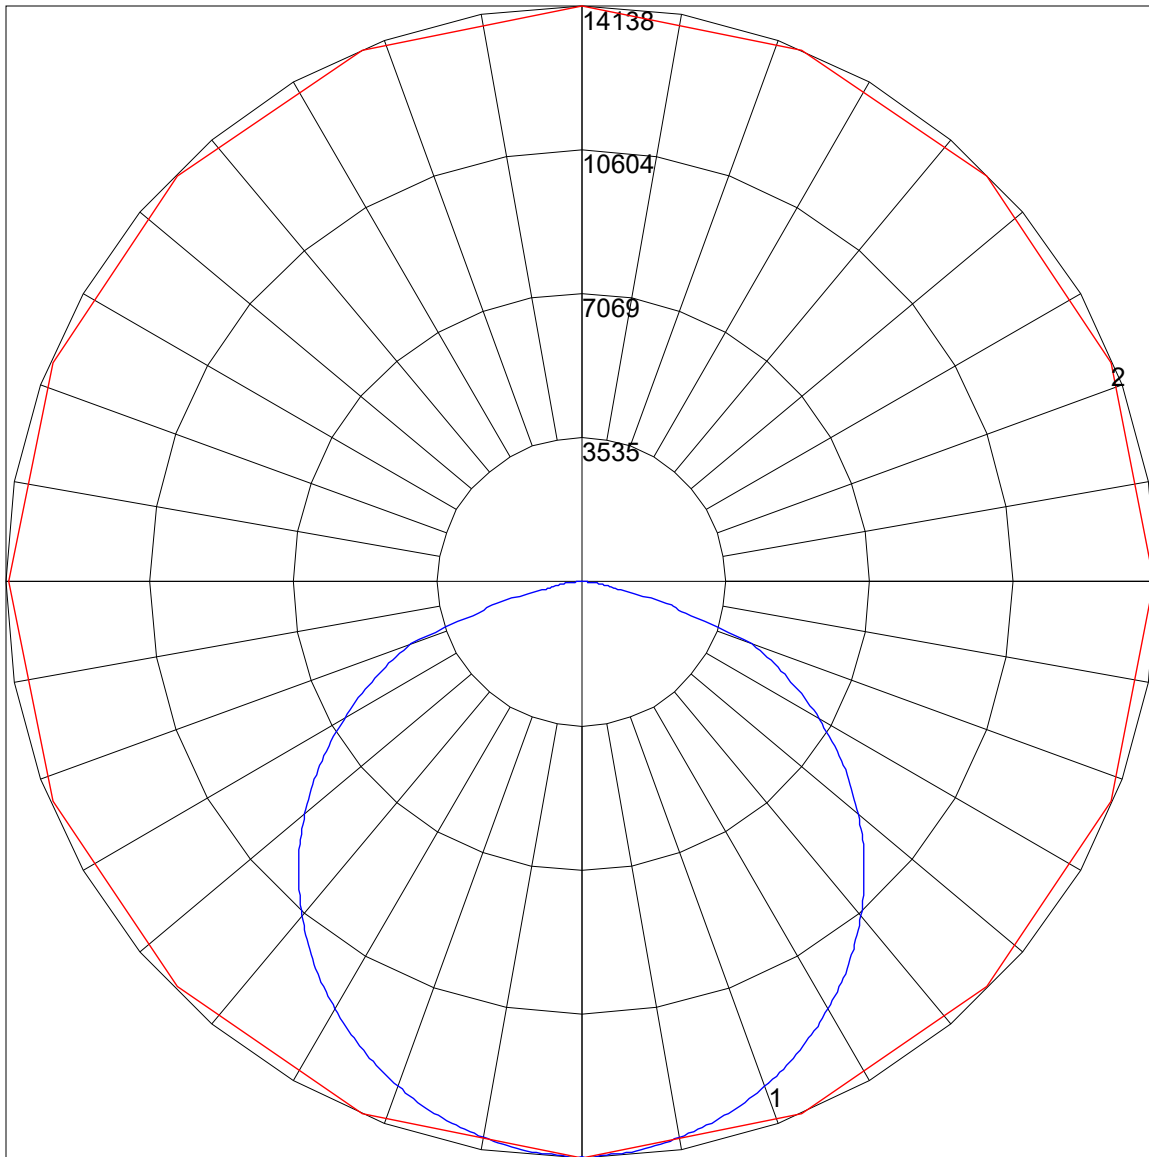

Maximum Candela = 14138.181 Located At Horizontal Angle = 90, Vertical Angle = .5
1 - Vertical Plane Through Horizontal Angles (90 - 270) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (.5) (Through Max. Cd.)