



## IES INDOOR REPORT

PHOTOMETRIC FILENAME : FPB 22 SEL(20W) UV FR 8SEL(3500K).IES

### DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] Nick

[TESTLAB] Ningbo TengLi Testing Co., Ltd

[TESTDATE] 14 October 2019

[ISSUEDATE] 2019-10-14 11:08:36

[NEARFIELD]

[LAMPPOSITION] 0,0

[OTHER] EVERFINE GO-R5000\_V2 SYSTEM

[MANUFAC] LumenFocus, LLC.

[LUMINAIRE] FPB 22 SEL(20W) UV FR 8SEL(3500K)

[OTHER]

[OTHER]	Gamma(deg)	Fz(lm)	Ft(lm)	%Lum	%Lamp
---------	------------	--------	--------	------	-------

[OTHER]	0- 10	119.34	119.34	3.26	3.26
---------	-------	--------	--------	------	------

[OTHER]	10- 20	342.13	461.47	12.60	12.60
---------	--------	--------	--------	-------	-------

[OTHER]	20- 30	519.71	981.17	26.79	26.79
---------	--------	--------	--------	-------	-------

[OTHER]	30- 40	628.76	1609.93	43.95	43.95
---------	--------	--------	---------	-------	-------

[OTHER]	40- 50	654.92	2264.85	61.83	61.83
---------	--------	--------	---------	-------	-------

[OTHER]	50- 60	594.44	2859.28	78.06	78.06
---------	--------	--------	---------	-------	-------

[OTHER]	60- 70	456.81	3316.09	90.53	90.53
---------	--------	--------	---------	-------	-------

[OTHER]	70- 80	268.49	3584.58	97.86	97.86
---------	--------	--------	---------	-------	-------

[OTHER]	80- 90	73.85	3658.42	99.88	99.88
---------	--------	-------	---------	-------	-------

[OTHER]	90-100	0.81	3659.23	99.90	99.90
---------	--------	------	---------	-------	-------

[OTHER]	100-110	0.40	3659.63	99.91	99.91
---------	---------	------	---------	-------	-------

[OTHER]	110-120	0.60	3660.23	99.93	99.93
---------	---------	------	---------	-------	-------

[OTHER]	120-130	0.70	3660.93	99.94	99.94
---------	---------	------	---------	-------	-------

[OTHER]	130-140	0.68	3661.61	99.96	99.96
---------	---------	------	---------	-------	-------

[OTHER]	140-150	0.56	3662.17	99.98	99.98
---------	---------	------	---------	-------	-------

[OTHER]	150-160	0.42	3662.59	99.99	99.99
---------	---------	------	---------	-------	-------

[OTHER]	160-170	0.28	3662.87	100.00	100.00
---------	---------	------	---------	--------	--------

[OTHER]	170-180	0.11	3662.98	100.00	100.00
---------	---------	------	---------	--------	--------

[OTHER]

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : FPB 22 SEL(20W) UV FR 8SEL(3500K).IES**

**CHARACTERISTICS**

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	2508
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	125
Total Luminaire Watts	20
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.26
Spacing Criterion (90-270)	1.28
Spacing Criterion (Diagonal)	1.40
Basic Luminous Shape	Rectangular
Luminous Length (0-180)	1.95 ft
Luminous Width (90-270)	1.95 ft
Luminous Height	0.00 ft

**LUMINANCE DATA (cd/sq.m)**

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	2293	2309	2339
55	2203	2223	2264
65	2058	2083	2139
75	1813	1852	1929
85	1262	1304	1490

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : FPB 22 SEL(20W) UV FR 8SEL(3500K).IES**

**ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	315.96	N.A.	12.60
0-30	671.79	N.A.	26.80
0-40	1102.29	N.A.	44.00
0-60	1957.71	N.A.	78.10
0-80	2454.31	N.A.	97.90
0-90	2504.87	N.A.	99.90
10-90	2423.16	N.A.	96.60
20-40	786.34	N.A.	31.40
20-50	1234.75	N.A.	49.20
40-70	1168.18	N.A.	46.60
60-80	496.60	N.A.	19.80
70-80	183.83	N.A.	7.30
80-90	50.56	N.A.	2.00
90-110	0.83	N.A.	0.00
90-120	1.24	N.A.	0.00
90-130	1.72	N.A.	0.10
90-150	2.56	N.A.	0.10
90-180	3.12	N.A.	0.10
110-180	2.29	N.A.	0.10
0-180	2507.99	N.A.	100.00

Total Luminaire Efficiency = N.A. %

**ZONAL LUMEN SUMMARY**

Zone	Lumens
0-10	81.71
10-20	234.25
20-30	355.83
30-40	430.50
40-50	448.41
50-60	407.00
60-70	312.77
70-80	183.83
80-90	50.56
90-100	0.55
100-110	0.27
110-120	0.41
120-130	0.48
130-140	0.46
140-150	0.38
150-160	0.29
160-170	0.20
170-180	0.07

**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : FPB 22 SEL(20W) UV FR 8SEL(3500K).IES**

**COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD**

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	109	104	99	95	106	101	97	94	97	94	91	93	90	88	89	87	85	83
2	99	90	83	77	96	88	82	76	85	79	75	81	77	73	78	75	71	69
3	90	79	71	64	87	77	70	64	74	68	62	72	66	61	69	64	60	58
4	82	70	61	54	80	69	60	54	66	59	53	64	57	52	61	56	52	49
5	75	62	53	47	73	61	53	46	59	52	46	57	50	45	55	49	45	43
6	70	56	47	41	68	55	47	40	53	46	40	52	45	40	50	44	39	37
7	64	51	42	36	63	50	42	36	48	41	35	47	40	35	46	39	35	33
8	60	46	38	32	58	46	37	32	44	37	32	43	36	31	42	36	31	29
9	56	43	34	29	55	42	34	29	41	33	28	40	33	28	39	33	28	26
10	53	39	31	26	51	39	31	26	38	31	26	37	30	26	36	30	26	24


**IES INDOOR REPORT**  
**PHOTOMETRIC FILENAME : FPB 22 SEL(20W) UV FR 8SEL(3500K).IES**

**UGR TABLE - CORRECTED**

Reflectances											
Ceiling Cavity		70	70	50	50	30	70	70	50	50	30
Walls		50	30	50	30	30	50	30	50	30	30
Floor Cavity		20	20	20	20	20	20	20	20	20	20
Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	14.9	16.5	15.2	16.8	17.1	15.0	16.7	15.4	17.0	17.3
	3H	16.7	18.2	17.1	18.5	18.8	16.9	18.4	17.3	18.7	19.1
	4H	17.3	18.8	17.7	19.1	19.5	17.6	19.0	18.0	19.4	19.7
	6H	17.8	19.2	18.3	19.5	19.9	18.1	19.4	18.5	19.8	20.2
	8H	18.0	19.3	18.4	19.6	20.0	18.3	19.6	18.7	19.9	20.3
	12H	18.1	19.3	18.5	19.7	20.1	18.4	19.6	18.8	20.0	20.4
4H	2H	15.5	16.9	15.9	17.3	17.6	15.7	17.1	16.1	17.4	17.8
	3H	17.5	18.7	17.9	19.1	19.5	17.8	18.9	18.2	19.3	19.7
	4H	18.3	19.4	18.8	19.8	20.3	18.6	19.7	19.0	20.1	20.5
	6H	19.0	19.9	19.4	20.4	20.8	19.3	20.2	19.7	20.7	21.1
	8H	19.2	20.1	19.6	20.5	21.0	19.5	20.4	20.0	20.8	21.3
	12H	19.3	20.1	19.8	20.6	21.0	19.7	20.5	20.1	20.9	21.4
8H	4H	18.7	19.6	19.1	20.0	20.5	18.9	19.8	19.4	20.3	20.7
	6H	19.4	20.2	19.9	20.6	21.1	19.7	20.5	20.2	21.0	21.4
	8H	19.7	20.4	20.2	20.9	21.3	20.0	20.7	20.5	21.2	21.7
	12H	19.9	20.5	20.4	21.0	21.5	20.3	20.9	20.8	21.3	21.9
12H	4H	18.7	19.5	19.2	20.0	20.5	19.0	19.8	19.5	20.2	20.7
	6H	19.5	20.2	20.0	20.6	21.2	19.8	20.5	20.3	20.9	21.5
	8H	19.8	20.4	20.3	20.9	21.4	20.2	20.7	20.7	21.2	21.8

Maximum UGR = 21.9

POLAR GRAPH

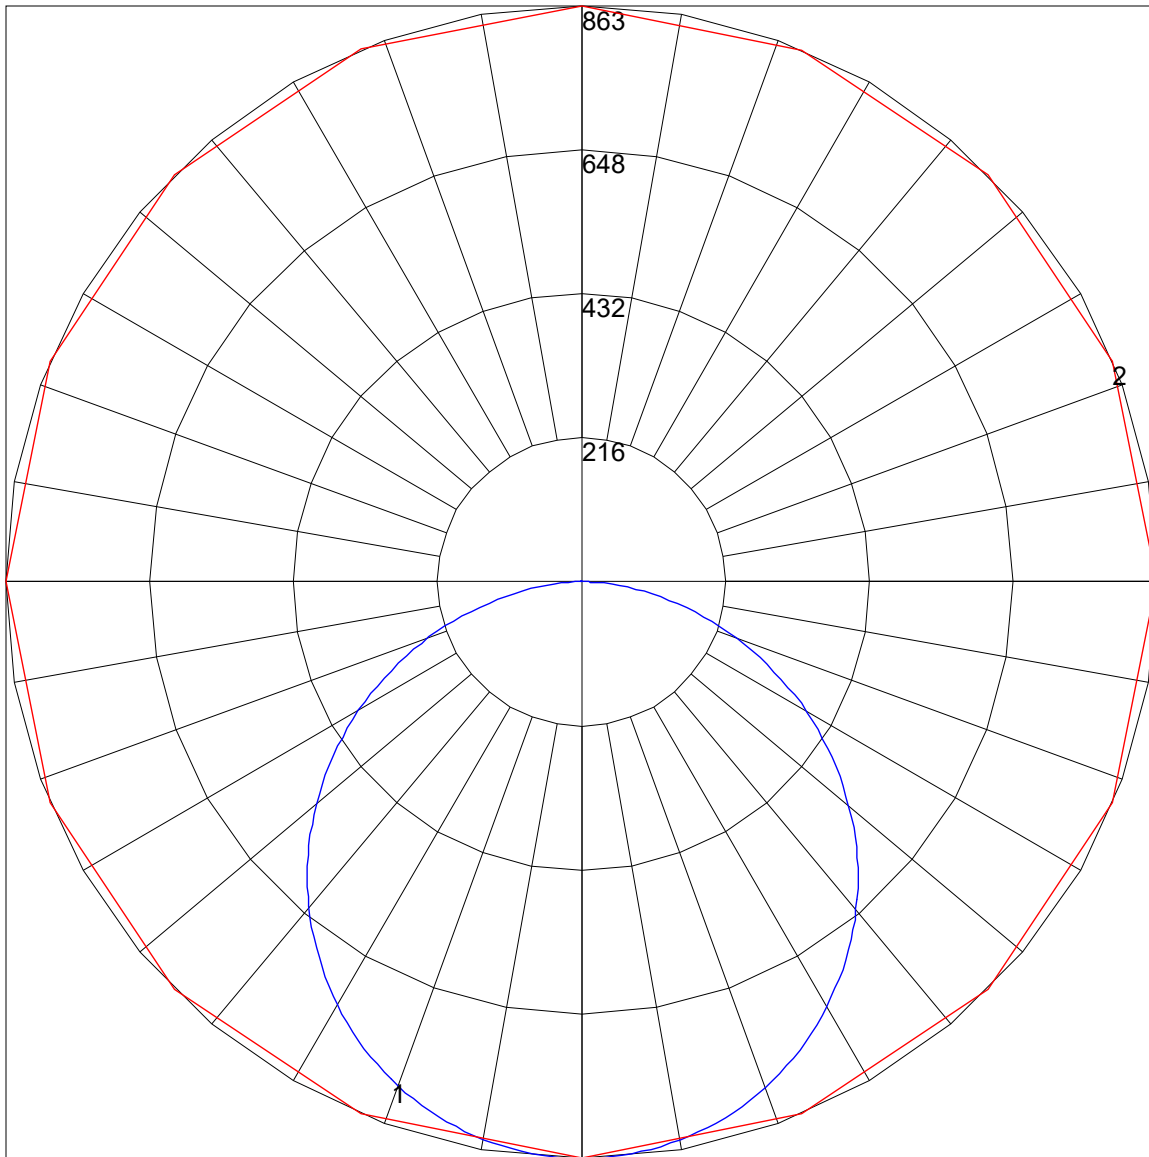

Maximum Candela = 863.49 Located At Horizontal Angle = 270, Vertical Angle = 1  
# 1 - Vertical Plane Through Horizontal Angles (270 - 90) (Through Max. Cd.)  
# 2 - Horizontal Cone Through Vertical Angle (1) (Through Max. Cd.)